



INDIRECT EVAPORATIVE COOLING



HEAT EXCHANGER

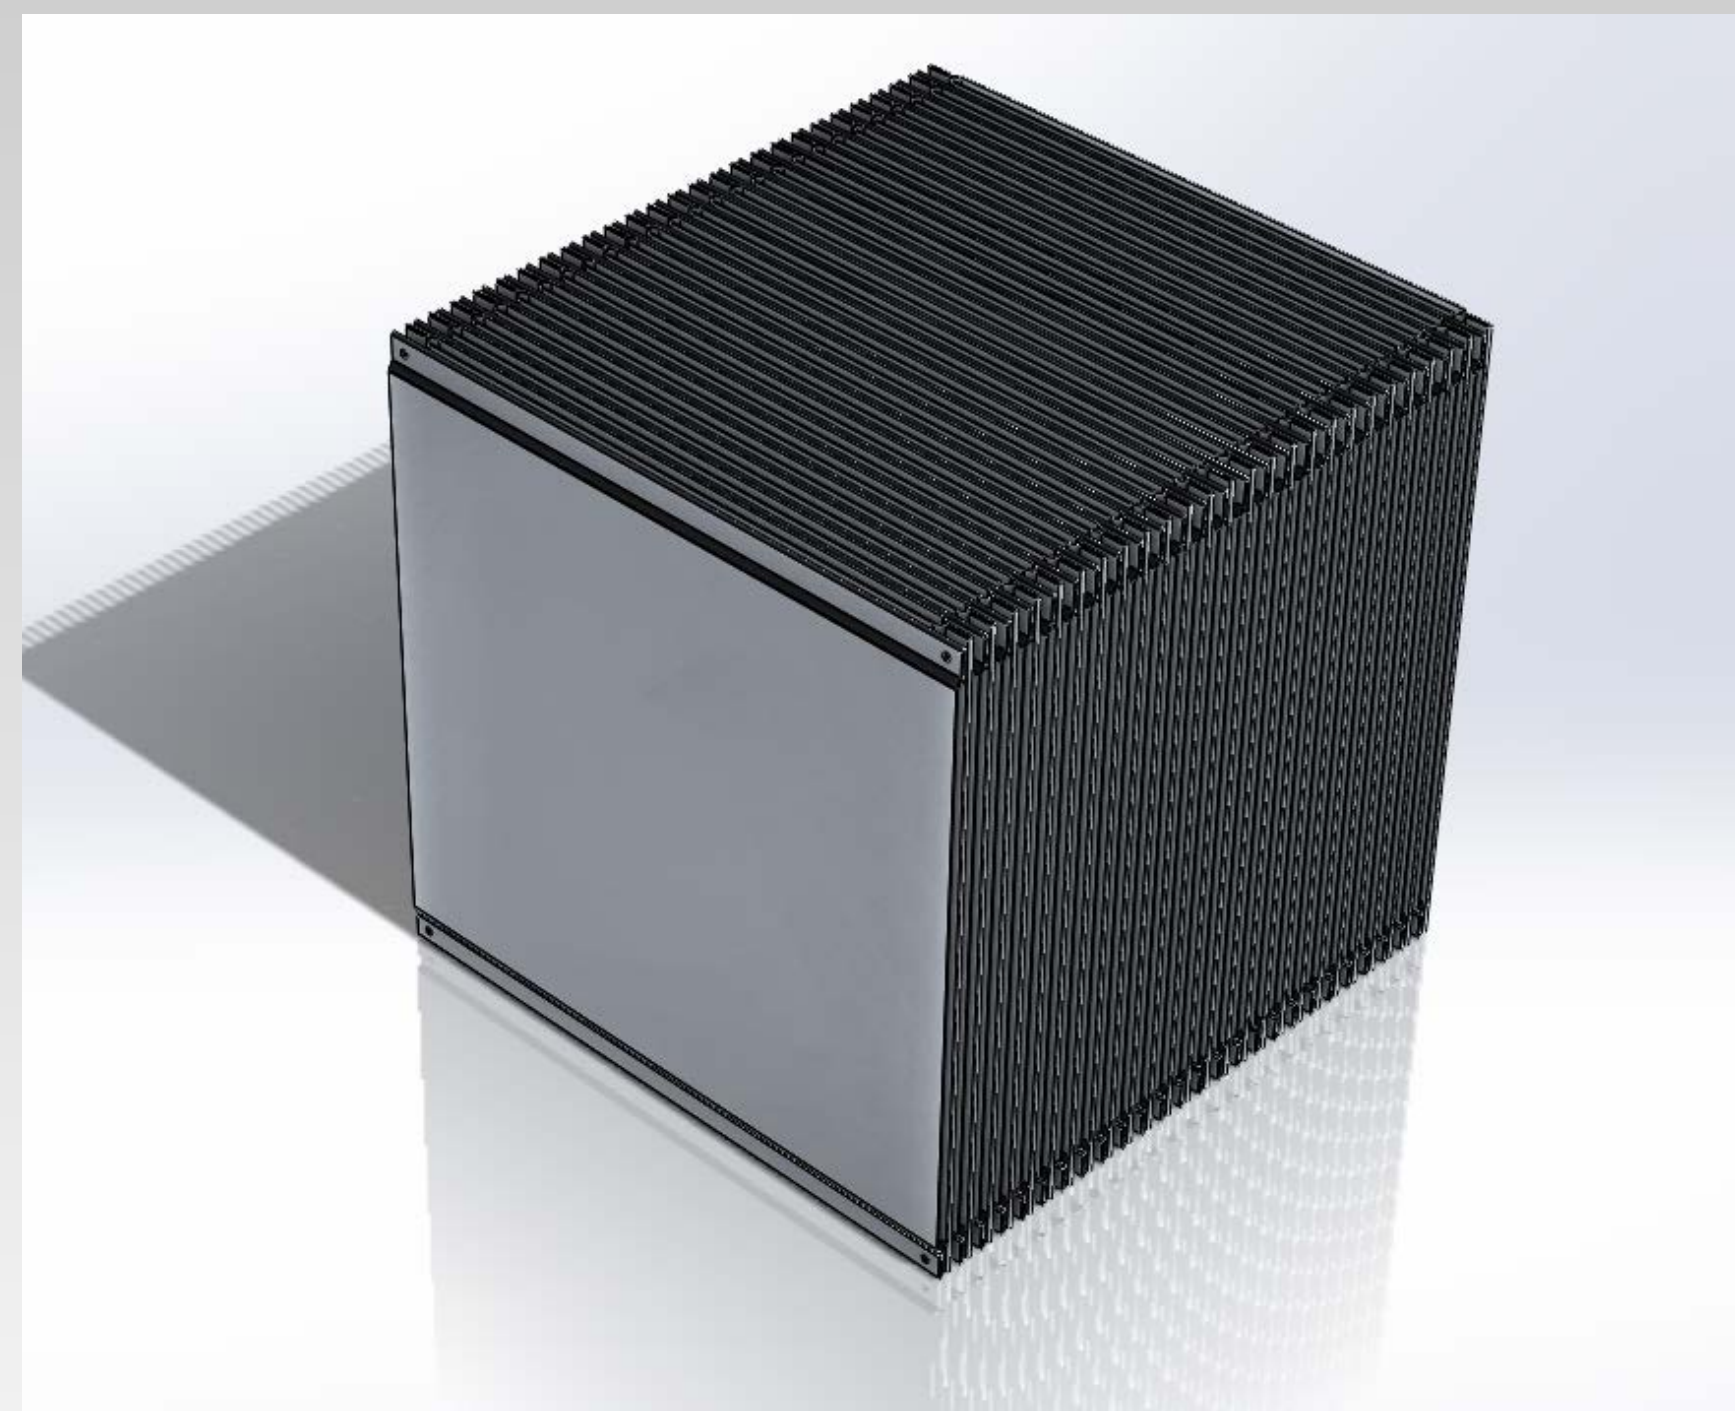

EVAPORATIVE SECTION

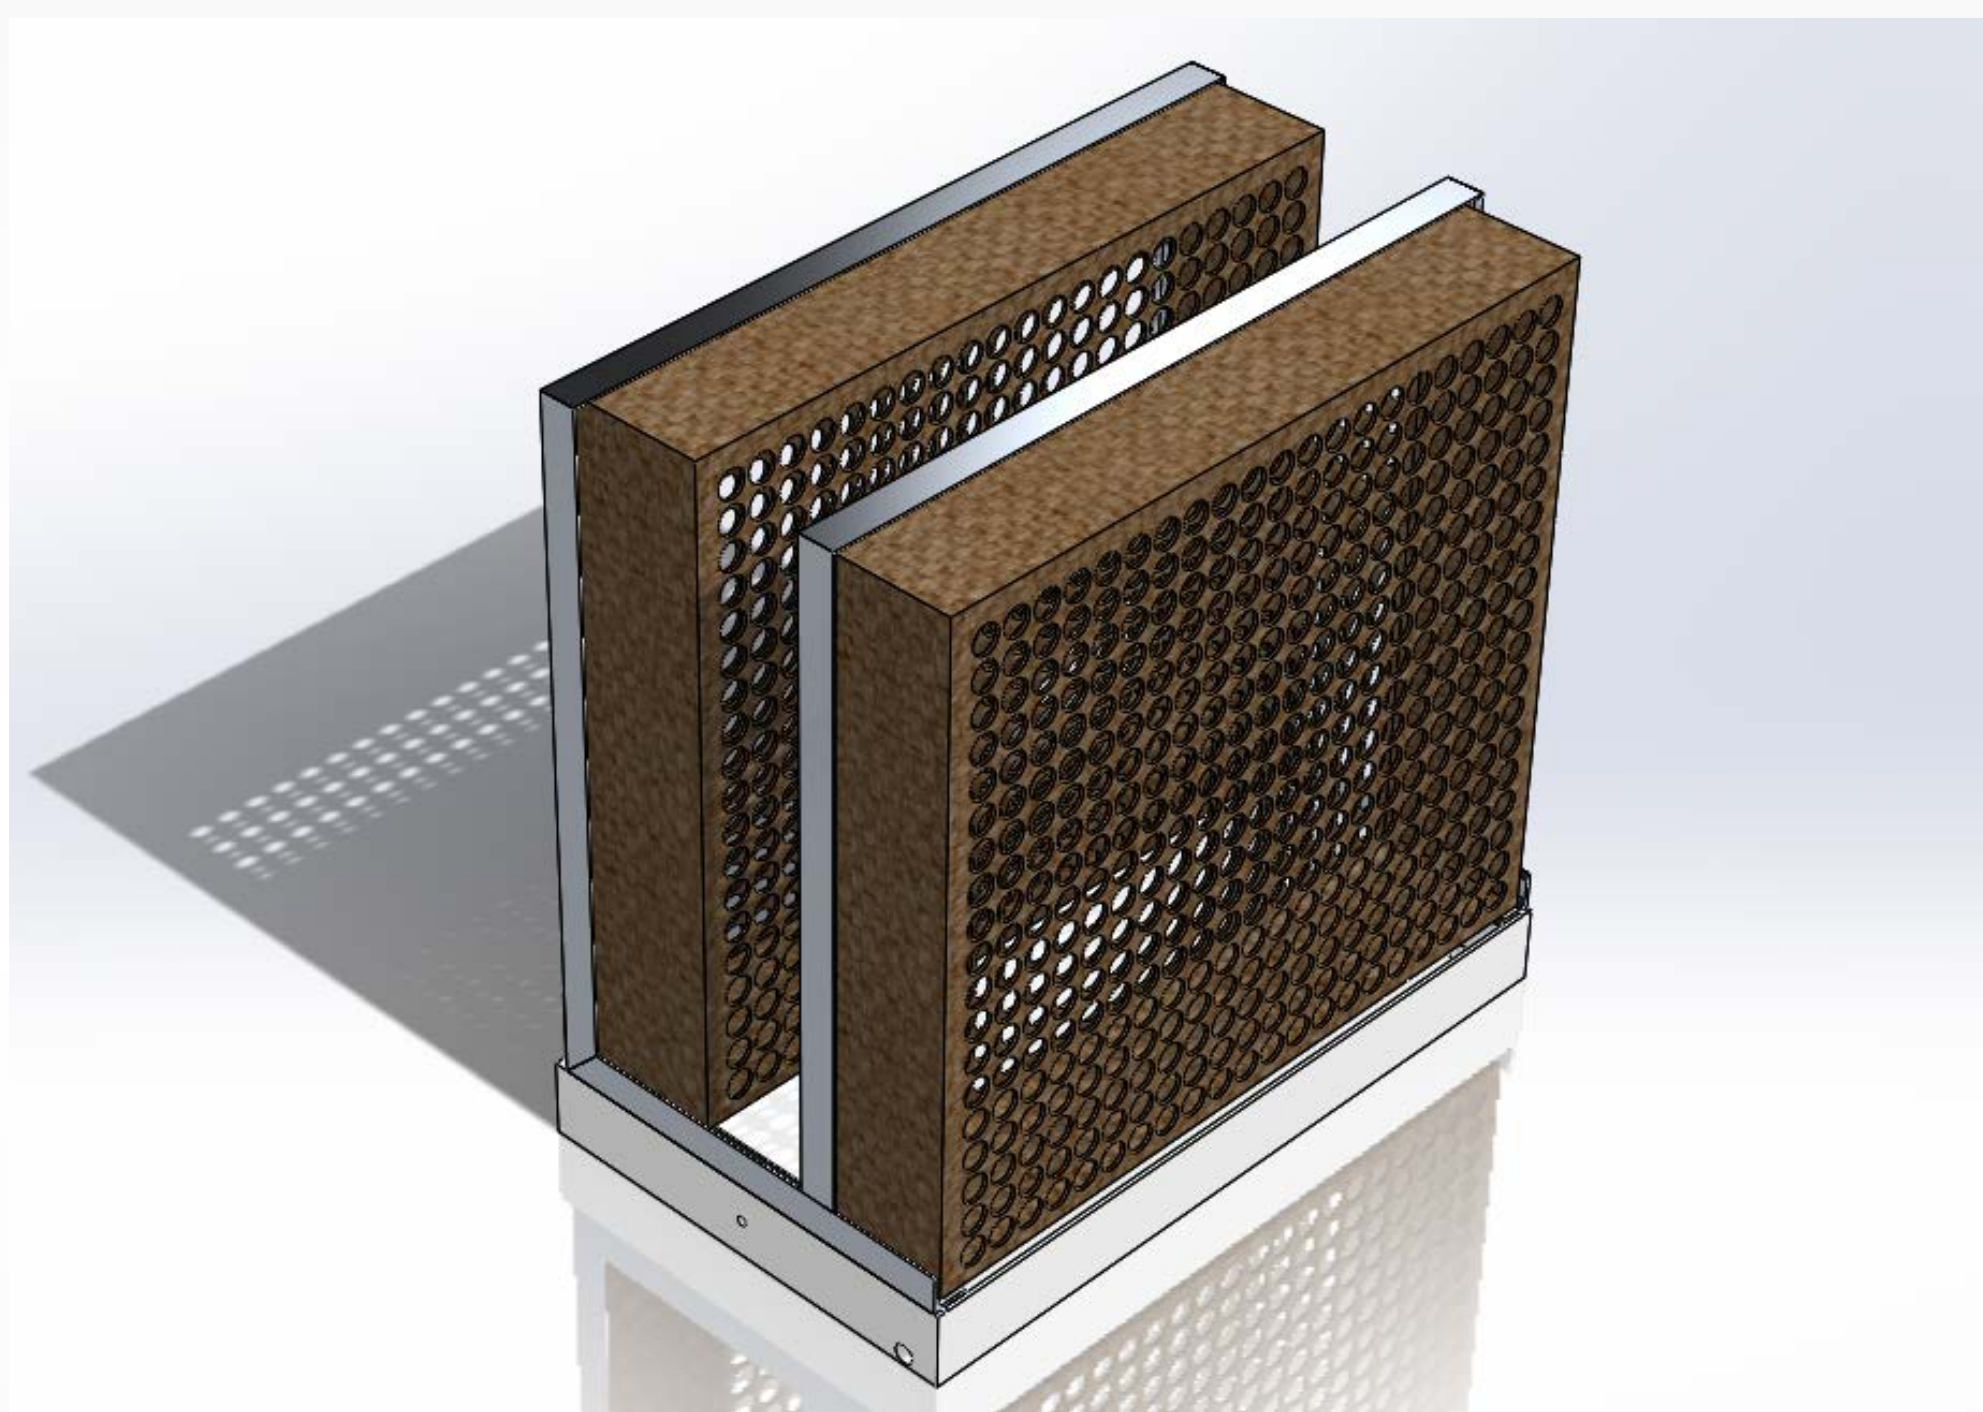

BLOWER

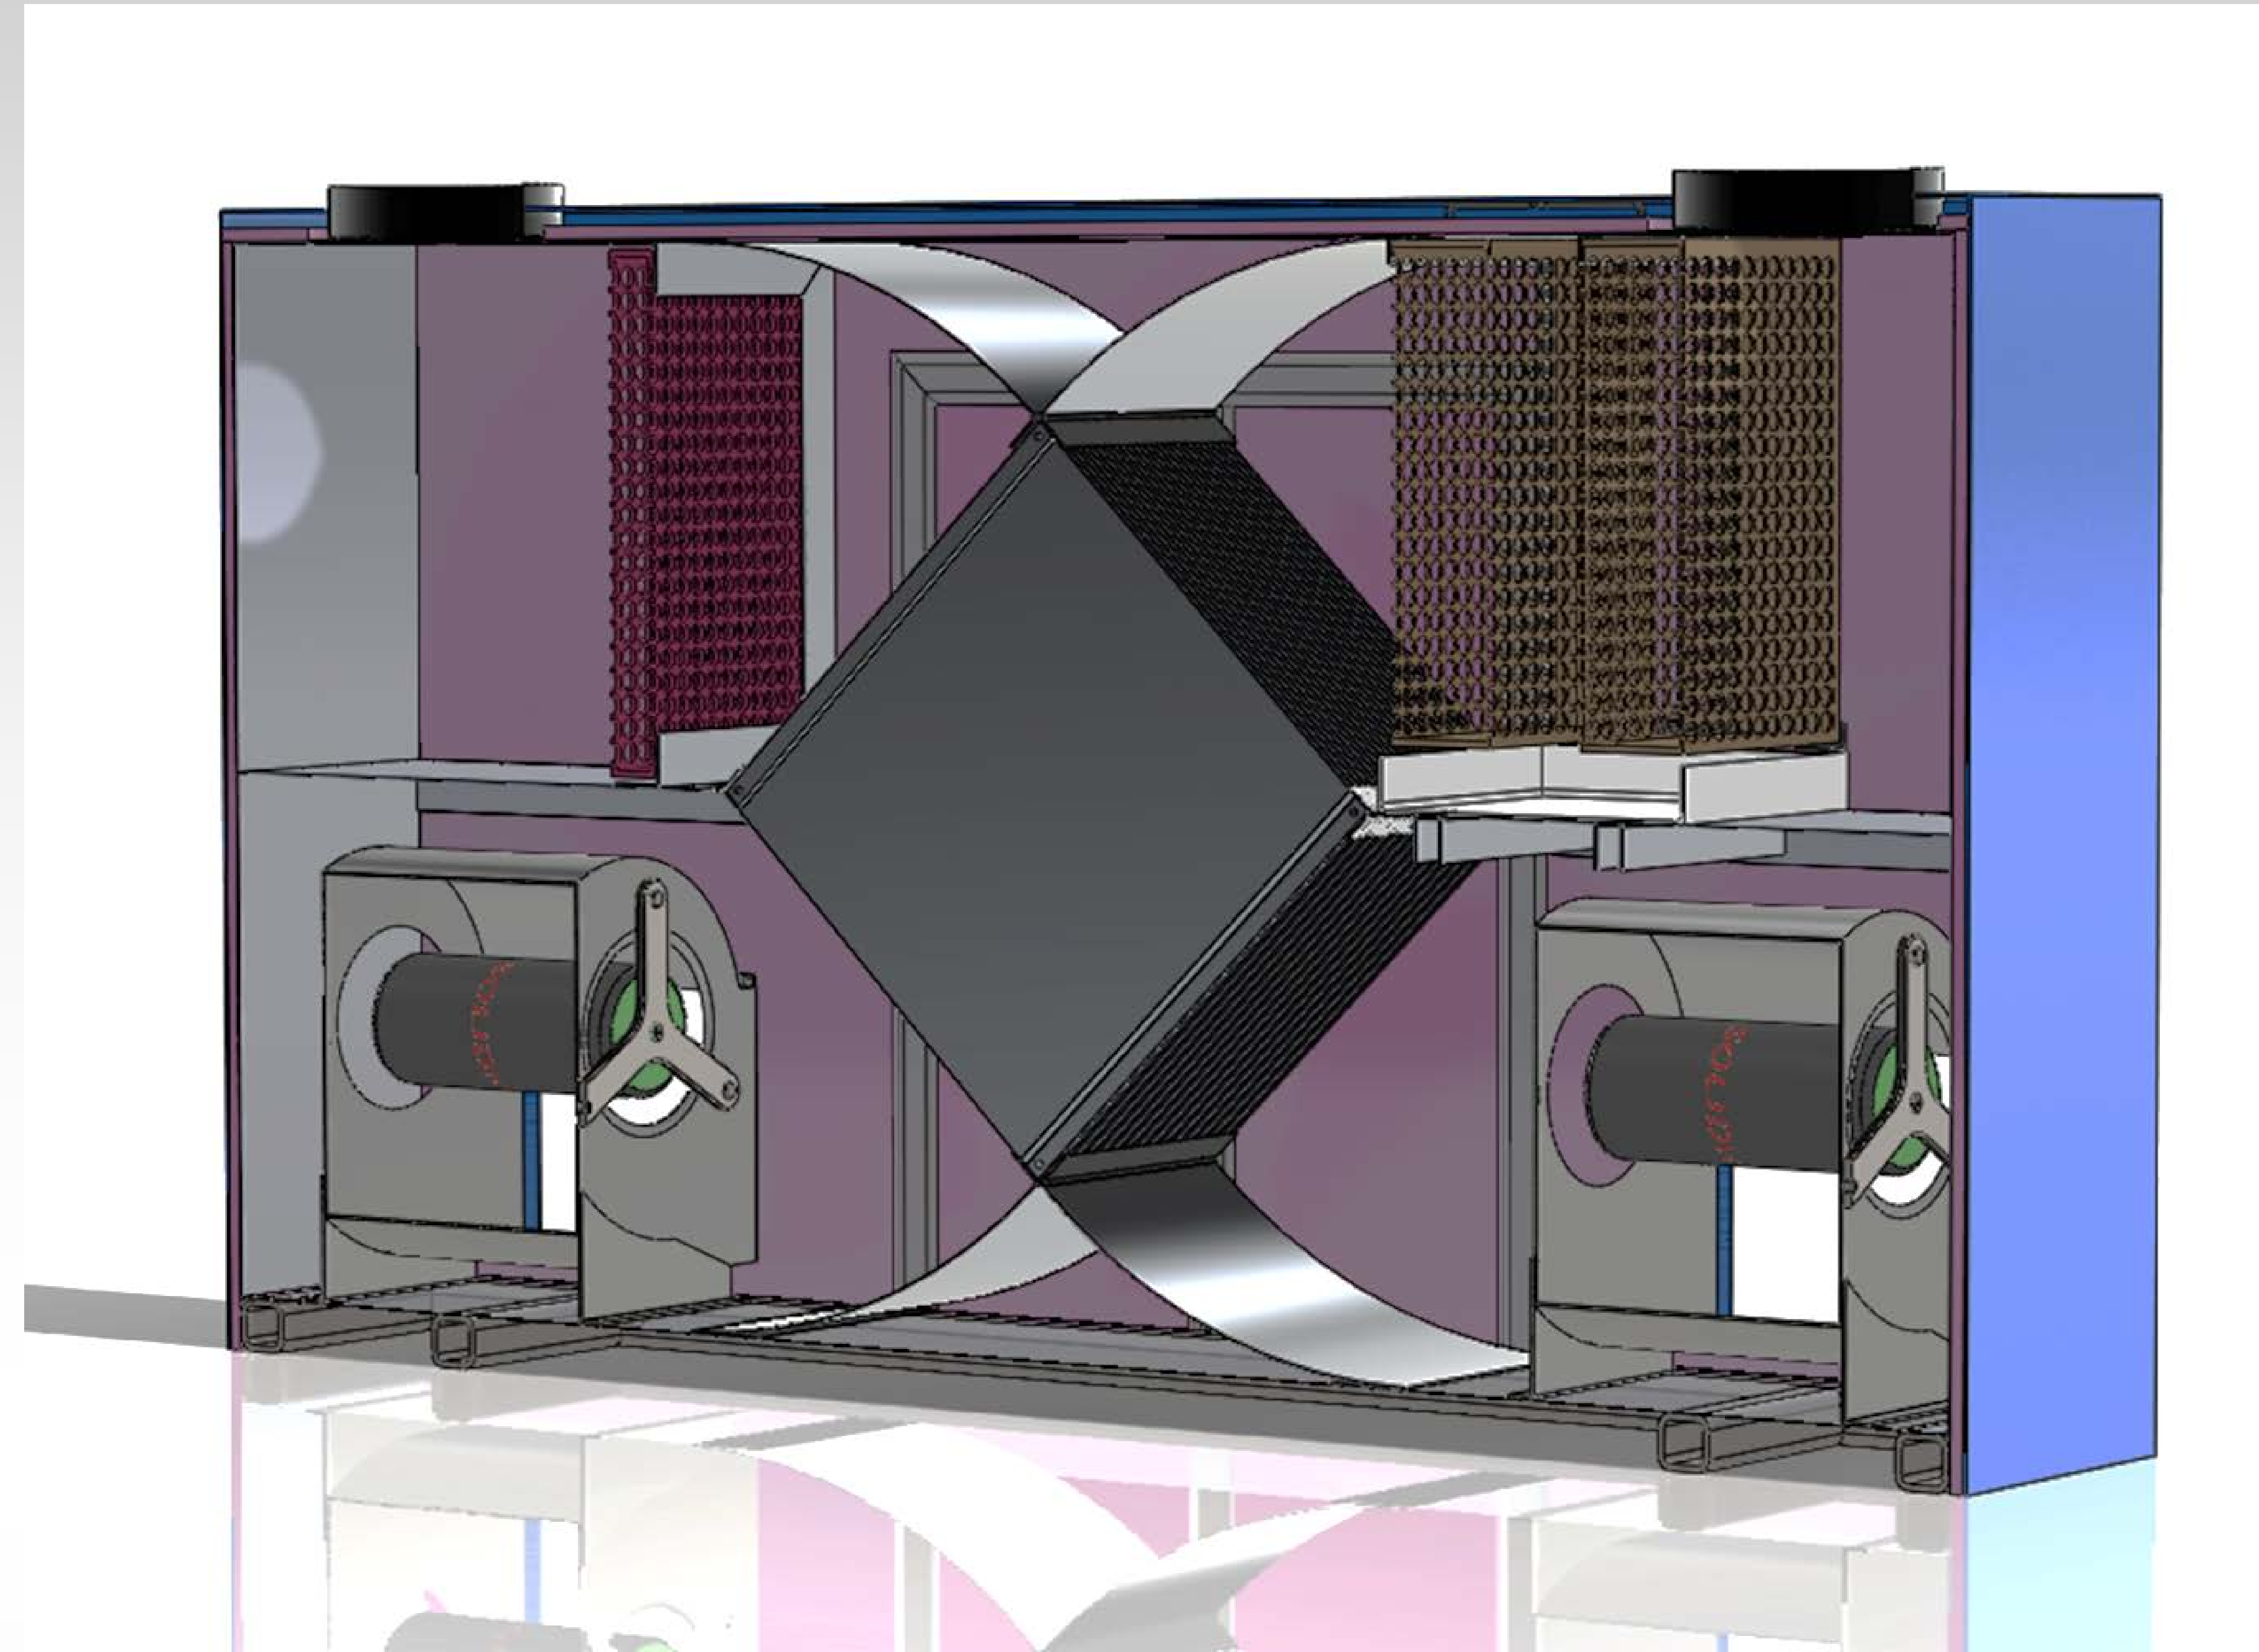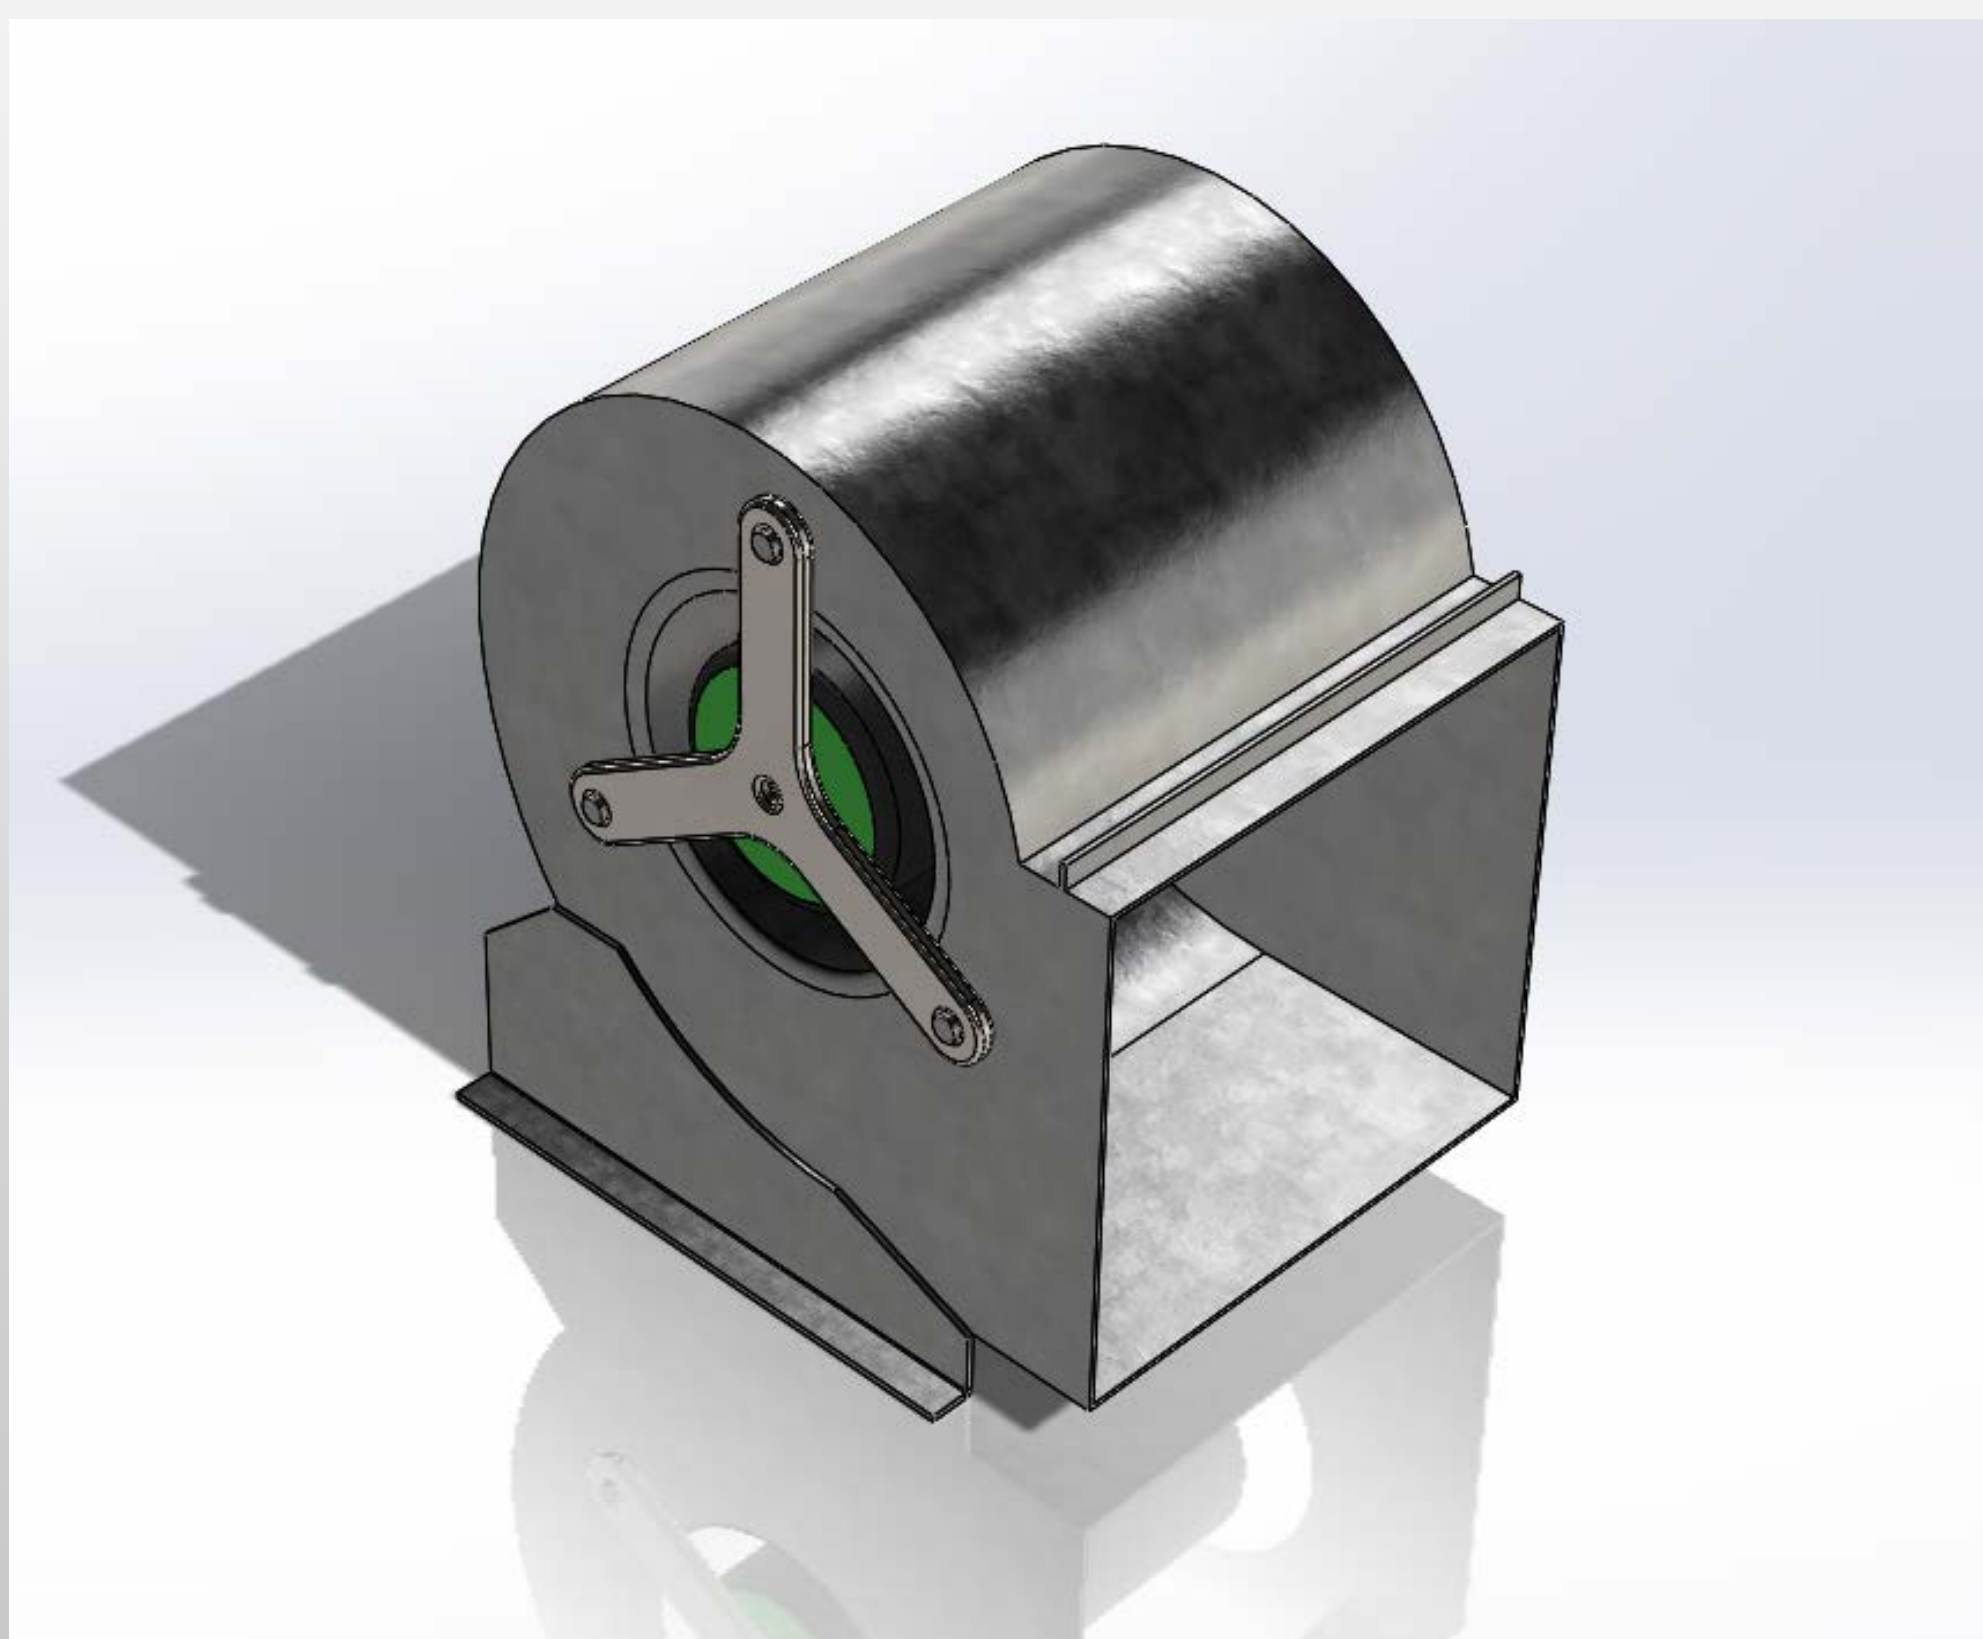

OBJECTIVE

To design an Indirect Evaporative Cooler to cool a home of 1,400 sq.ft. from 30°C to 20°C.



FLOW SIMULATIONS

